OPERATION MANUAL

OFFICE PRO 10

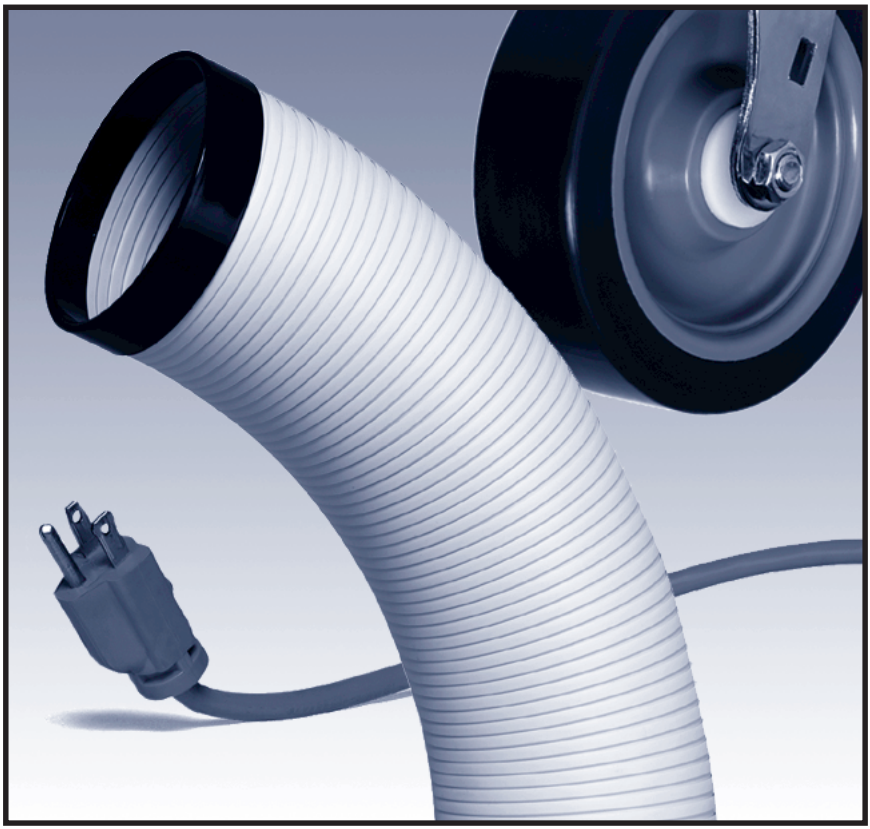

READ THIS MANUAL CAREFULLY FOR INSTRUCTIONS ON CORRECT INSTALLATION AND USAGE, AND READ ALL SAFEGUARDS.

c UL US LISTED

MOVINCOOL®
THE PORTABLE SPOT COOLING SOLUTION

© 2003 DENSO SALES CALIFORNIA, INC.
All rights reserved. This book may not be reproduced or copied, in whole or in part, without the written permission of the publisher. DENSO SALES CALIFORNIA, INC. reserves the right to make changes without prior notice. MovinCool is a registerd trademark of DENSO Corporation.

OPERATION MANUAL

OFFICE PRO 10

MOVINCOOL®
THE PORTABLE SPOT COOLING SOLUTION

Table of Contents

FOREWORD 1
Definition of Terms 1
GENERAL WARNINGS & CAUTIONS 2
INVENTORY 3
INSTALLATION 4
Choosing an Installation Site 4
Moving the Unit 5
Plugging in the Unit 6
FEATURES 7
OPERATION 8
Control Panel 8
Operating in COOL Mode 10
Operating in Fan Only Mode 10
Changing from Fan Only Mode to COOL Mode 10
Programming the Unit 11
To Set a Program 12
Operating Modes 16
Emptying the Drain Tank 17
Installing the Condenser Plenum and Reducer 18
Accessory Kit 19
Accessory Kit Instructions 20
Remote Control (Optional) 22
Drain Pump Kit (Optional) 23
DAILY INSPECTION & MAINTENANCE 24
Emptying the Drain Tank 24
Cleaning the Air Filters 24
Filter Removal Method 24
Filter Cleaning Method 25
In-Season/Off-Season Inspection & Maintenance 25
TROUBLESHOOTING 26
Self-Diagnostic Codes 26
TECHNICAL SPECIFICATIONS 27

FOREWORD

Congratulations on purchasing the MovinCool portable air conditioner.

This manual explains how to install and operate the MovinCool Office Pro 10 portable air conditioning unit. Please read this operation manual thoroughly to familiarize yourself with the features of the unit and to ensure years of reliable operation. You may also find it useful to keep this operation manual on hand for reference.

Components and/or procedures are subject to change without prior notice.

Definition of Terms

⚠WARNING: Describes precautions that should be observed in order to prevent injury to the user during installation or unit operation.

⚠CAUTION: Describes precautions that should be observed in order to prevent damage to the unit or its components, which may occur during installation or unit operation if sufficient care is not taken.

NOTE: Provides additional information that facilitates installation or unit operation.

GENERAL WARNINGS & CAUTIONS

- All electrical work, if necessary, should only be performed by qualified electrical personnel. Repair to electrical components by non-certified technicians may result in personal injury and/or damage to the unit. All electrical components replaced must be genuine MovinCool parts, purchased from an authorized reseller.
- The proper electrical outlet for MovinCool units must be equipped with a UL approved ground-fault breaker to prevent electrical shock from the unit.
- Because of potential safety hazards under a certain condition, we strongly recommend against the use of an extension cord. However, if you still elect to use an extension cord, it is absolutely necessary that it will be a UL listed, 3-wire grounding type appliance extension cord, having a 3-blade grounding plug and a 3-slot receptacle that will plug into the appliance. The marked rating of the extension cord should be 115 V, 15 A or equivalent.
- The Office Pro 10 is equipped with a six (6) foot (1.8 meter) power cord. If replacement, fixed location (hard wired) or power cord lengthening (extension cord) cords are required, contact your reseller or a qualified electrician for approved replacement methods.
- Never fold or place heavy objects on the power cord. This could result in damage to the power cord causing electrical shock or fire.
- Do not place water or any other liquid on the unit. This can cause damage to the unit and increase the risk of electrical shock.
- Do not sit or stand on the unit.

INVENTORY

After unpacking your MovinCool unit, please check to make sure you have the following items:

- Office Pro 10 MovinCool Unit (1)
- Operation Manual/Warranty Card (1)
- Accessory Kit (1)

NOTE: If any of these items were not included in the box or appear damaged, please contact your MovinCool reseller for replacement.

OFFICE PRO 10 MOVINCOOL UNIT

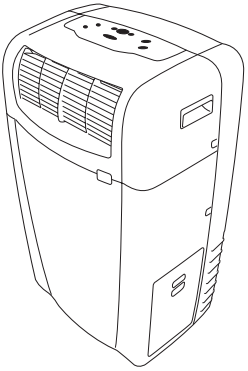

ACCESSORY KIT

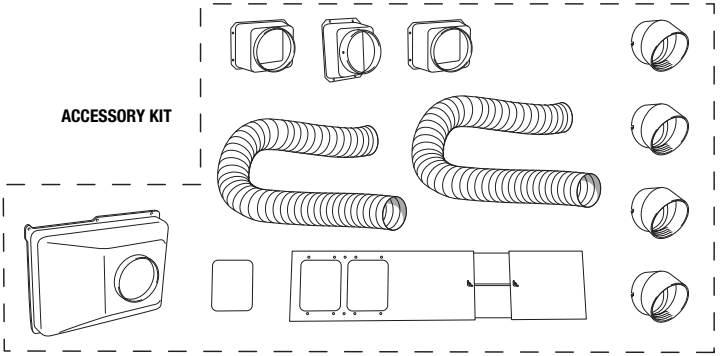

OPERATION MANUAL / WARRANTY CARD

INSTALLATION

Choosing an Installation Site

⚠CAUTION: The following are some precautions to consider before choosing your installation site. Please review carefully as improper installation may result in personal injury or damage to the unit.

- Do not use the unit in areas where leakage of flammable gas may occur.
- Do not use the unit in areas where it will be exposed to rain or water.
- Do not use the unit in an atmosphere of excessively corrosive gas or vapor.
- Do not use the unit in areas where the temperature is outside the allowable operating range.
- Do not install the unit in sloping areas. The unit may move or topple over even if the casters are set to the LOCKED position.
- Install the unit in areas that can withstand the weight of the unit. The Office Pro 10 unit weighs approximately 130 lbs (59 kg) (when the drain tank is full of water).
- Allow 20 inches of unobstructed airflow for both the air inlets and outlets. The inlets are located on the back of the unit. The outlets are located on the front of the unit.
- Do not use the unit above 95˚F 60% RH.

INSTALLATION (cont.)

Moving the Unit

Unlock the casters and push the MovinCool unit using the side handles to a flat, level surface and set the casters back to the LOCKED position.

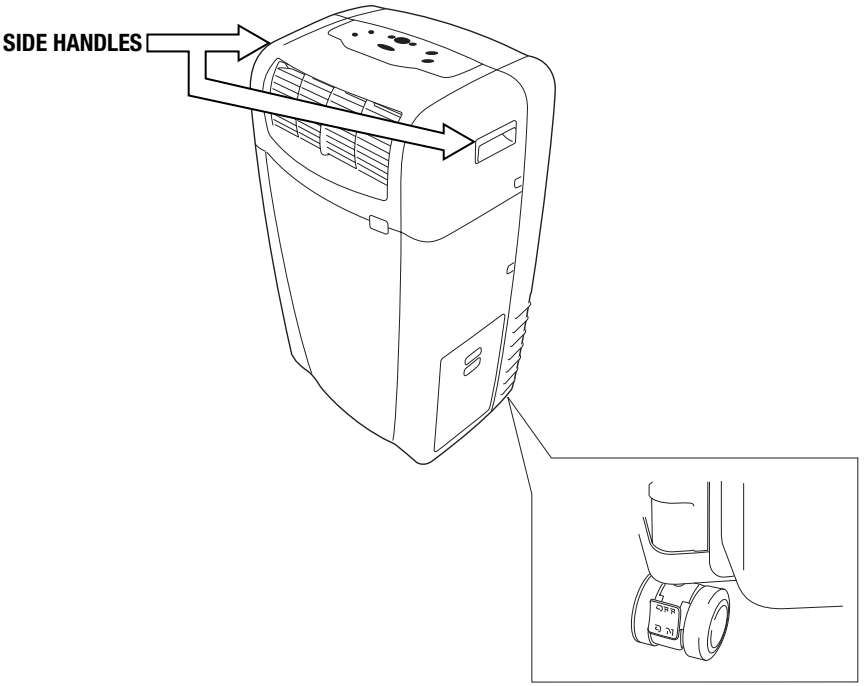

INSTALLATION (cont.)

Plugging in the Unit

- Check the prongs and surface of the power cord plug for dust/dirt. If dust and/or dirt are present, wipe off with a clean, dry cloth.
- Check the power cord, plug and prongs for damage or excess play. If any damage or excess play is found, contact your MovinCool reseller for repair.

⚠WARNING:

- **If the power cord or plug is damaged, repair should only be performed by qualified electrical personnel.**
- **Do not connect/disconnect the power cord or attempt to operate buttons with wet hands. This could result in electrical shock.**

⚠CAUTION:

- **The AC outlet (115 VAC Single Phase, 60Hz) needs to be rated at 15A or higher. Do not share the outlet with any other instrument or equipment.**

NOTE:

- ***Make sure the AC outlet is free of dirt, dust, oil, water, or any other foreign matter.***
- ***The Office Pro 10 model is equipped with an approved NEMA plug configuration (5-15). The appropriate outlet must be used for this plug type.***

FEATURES

- An electronic control panel, which allows the user to control the unit's operation easily.
- Dual fan speeds (either HIGH or LOW) in both COOL and Fan Only modes.
- Digital display that indicates the temperature set point (either Fahrenheit or Celsius) in which the COOL Mode will operate. This is also the temperature the unit will try to maintain. The Temperature set point can be adjusted between LO 65ºF ~ 90ºF HI by the key down/key up buttons (∨/∧).
- A condensate drain

indicator display (LED).
- An automatic restart feature when the power is lost and regained. The unit will return to the operating mode it was in prior to the loss of power. Any preset program will be retained in the memory in the event power loss occurs.
- A programmable Clock/Timer function. This allows the user to program a specific time of day that the unit will begin to operate/start and turn off/end (Automatic Operation). The user can also program the amount of days within the week the unit will cool.
- A two-digit room temperature display.
- A programmable temperature function.

OPERATION

Control Panel

Before operating the unit, it is important to familiarize yourself with the basic controls located on the control panel.

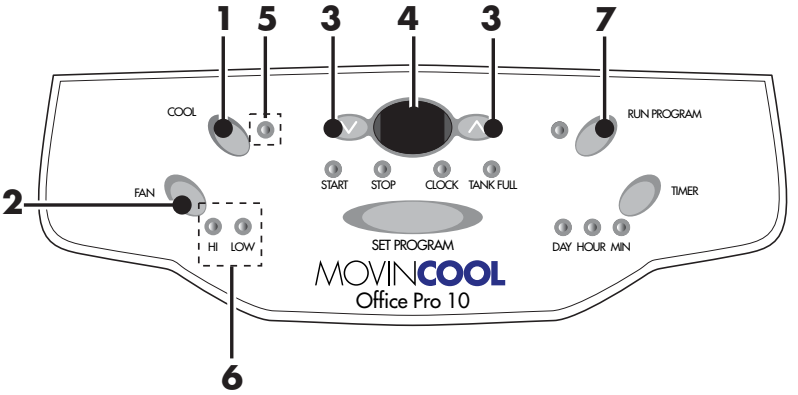

1 **COOL** Button

Activates/deactivates the COOL mode/turns the unit off.

2 **FAN** Button



Activates/deactivates the HIGH or LOW fan mode.

3 Key Down/Key Up Buttons (∨/∧)

Decreases/Increases the temperature set point; also used to change the day of the week, hours and minutes when programming.

4 Info Display Area



Indicates the current room temperature, self-diagnostic codes (see page 26), set point temperatures, and also displays program information.

5 **COOL** LED

Illuminates to indicate cooling is activated or unit is ready to cool.

6 **HI/LOW** LED

Illuminates to indicate HI or LOW fan operation.

7 **RUN PROGRAM** Button

Activates a program.

OPERATION (cont.)

Control Panel (Cont.)

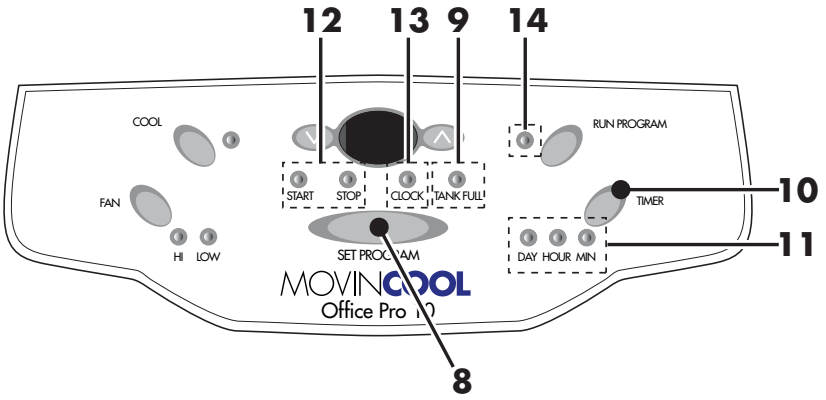

8 SET PROGRAM Button

Allows the user to program the unit or check the current program.

9 TANK FULL LED

Illuminates to indicate the tank is full.

10 TIMER Button

Allows the user to set the clock and program the start time and end time of operation.

11 DAY/HOUR/MIN LED

Illuminates to indicate the day, hour, and minutes for programming functions.

12 START/STOP LED

Illuminates to indicate the start and stop operation during program mode.

13 CLOCK LED

Illuminates to indicate clock programming sequence during program mode.

14 RUN PROGRAM LED

Illuminates to indicate a program is running. No illumination indicates unit is in manual mode.

OPERATION (cont.)

Operating in COOL Mode

- The unit can be operated in COOL mode by pressing COOL (LED illuminates).

NOTE: In COOL mode the unit can only be turned off by pressing COOL ***again, not by pressing the fan buttons.***

- Change the fan speed by pressing FAN .
- Change the temperature set point by pressing the key down/key up buttons (∨/∧).

NOTE: When turning the unit on, the set point and fan speed are determined by the last operating mode (program mode not included). Ten seconds after the set temperature button has been pressed in manual mode, the display will revert back to the current room temperature.

Operating in Fan Only Mode

- The unit can also be operated in Fan Only mode by pressing either FAN (HI or LOW LED illuminates).
- The unit can then be turned off by pressing the fan speed button that is illuminated.

Changing from Fan Only Mode to COOL Mode

- The COOL mode can be activated while the unit is operating in Fan Only mode. To do this, simply press COOL (LED illuminates).

NOTE: The Fan Only mode will not operate after the COOL mode has been activated. After the COOL mode has been activated, the unit cannot be turned off by pressing the fan buttons. The COOL button must be pressed.

OPERATION (cont.)

Programming the Unit

In order to use the programming function of the Office Pro 10, the current time and day of the week must be set.

Make sure the unit is plugged in.

- Press SET PROGRAM four times until CLOCK is illuminated.
- The display will indicate a day of the week code and DAY will illuminate. Press the ∨/∧ buttons to set the day of the week. Press TIMER to advance.

MO = MONDAY
TU = TUESDAY
WE = WEDNESDAY
TH = THURSDAY
FR = FRIDAY
SA = SATURDAY
SU = SUNDAY

Day Conversion Chart

- The display and HOUR will illuminate. Press the ∨/∧ buttons to set the current hour. The Office Pro 10 utilizes Military time. See chart for conversion from Military to Standard time. Press TIMER to advance.

Note: The Office Pro 10 clock will have to be reset for Daylight Savings Time.

01	= 1AM	13	= 1 PM
02	= 2AM	14	= 2 PM
03	= 3AM	15	= 3 PM
04	= 4AM	16	= 4 PM
05	= 5AM	17	= 5 PM
06	= 6AM	18	= 6 PM
07	= 7AM	19	= 7 PM
08	= 8AM	20	= 8 PM
09	= 9AM	21	= 9 PM
10	= 10 AM	22	= 10 PM
11	= 11AM	23	= 11 PM
12	= 12PM	00	= 12 AM

Military to Standard Conversion Chart

- The display and MIN will illuminate. Press the ∨/∧ buttons to set current minutes. Press SET PROGRAM four times to exit programming mode and finish.

OPERATION (cont.)

To Set a Program

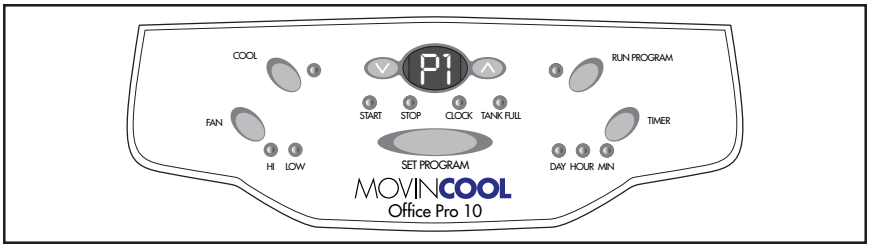

Display shows Program 1

1. Press SET PROGRAM and P1 will show in the display. There are 7 available options for programming (P1 - P7).
2. Press ∨/∧ to choose which program to edit. (P1 - P7)

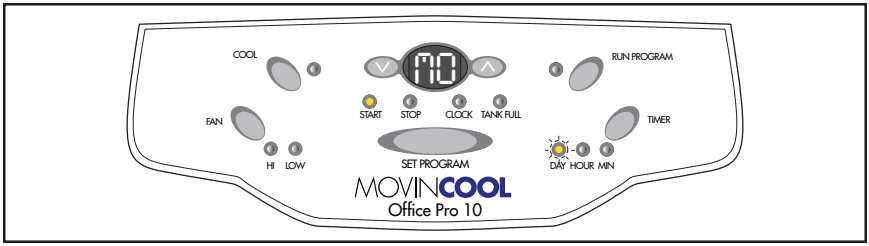

Display shows Monday

3. Press SET PROGRAM until START is illuminated.
4. The display will indicate a day of the week code and DAY will illuminate. Press the ∨/∧ buttons to set the day of the week. Press TIMER to advance.

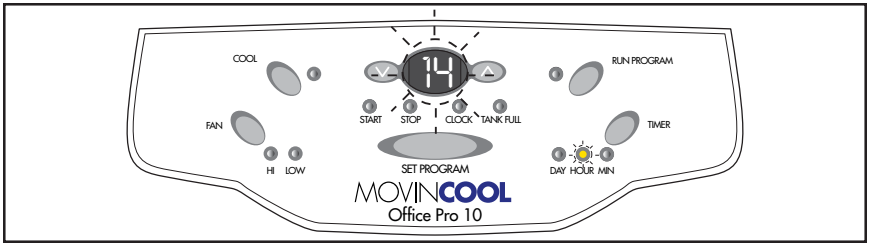

Hour start time is 2:00 P.M.

5. HOUR and display will illuminate. Use ∨/∧ to set desired hour start time. The Office Pro 10 utilizes Military time. See chart for conversion from Military to Standard time on page 11. Press TIMER to advance to minutes.

OPERATION (cont.)

To Set a Program (Cont.)

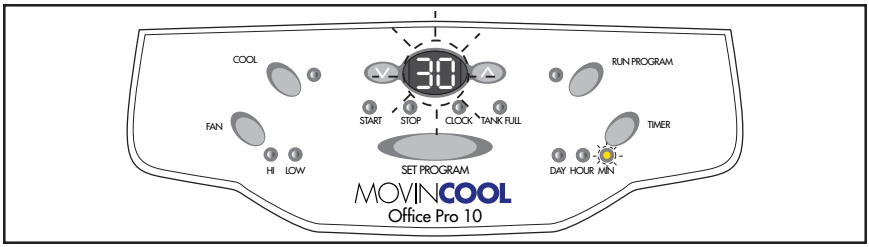

P1 start time is now 2:30 P.M.

6. MIN and display will illuminate. Use ∨/∧ to set desired minute start time.

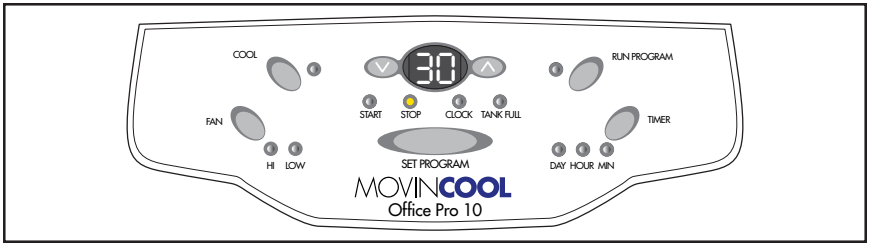

STOP LED is illuminated

7. Press SET PROGRAM until STOP is illuminated.
8. Repeat steps 4,5 & 6 to set program STOP day and time.

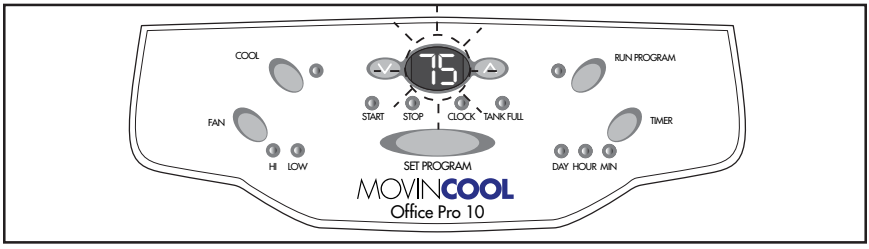

Display shows current set temperature flashing

9. Press SET PROGRAM until the information display area is flashing the current set temperature.
10. Use ∨/∧ to set a new set point temperature. Press SET PROGRAM to advance to fan mode.

OPERATION (cont.)

To Set a Program (Cont.)

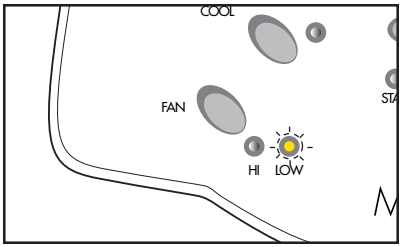

Display shows FAN LOW

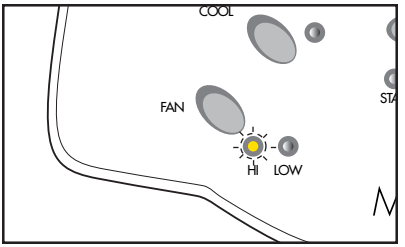

Display shows FAN HI

11. To change fan speed, press FAN until HI LOW (HI/LOW) begin to flash. This is the current programmed Fan Speed. Press SET PROGRAM to advance to Cooling mode.

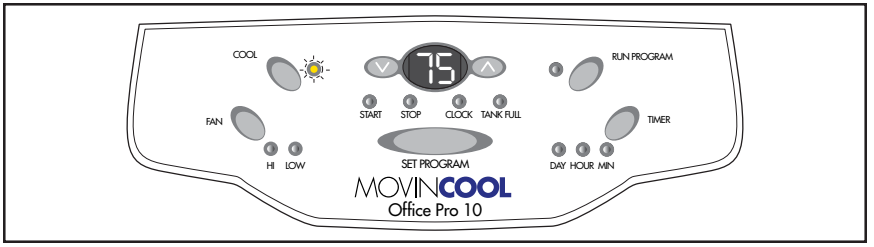

COOL LED is flashing

12. Press ∨/∧ buttons to cycle between Cool and Fan only modes. For Cool mode, COOL will flash. For Fan mode, HI LOW will flash.

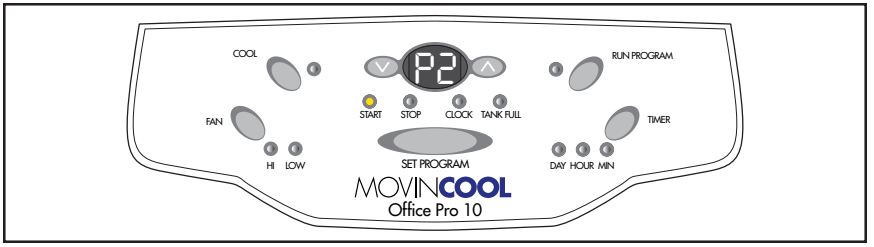

Display shows new Program 2

13. Press RUN PROGRAM to run current program or
14. Press SET PROGRAM to edit current program or to enter a new program.

OPERATION (cont.)

Note: Pressing

repeatedly will cycle through program options.

Set Program ⇨ Start ⇨ Stop ⇨ Clock ⇨ Set Temperature ⇨ Fan ⇨ Cool ⇨ Exit

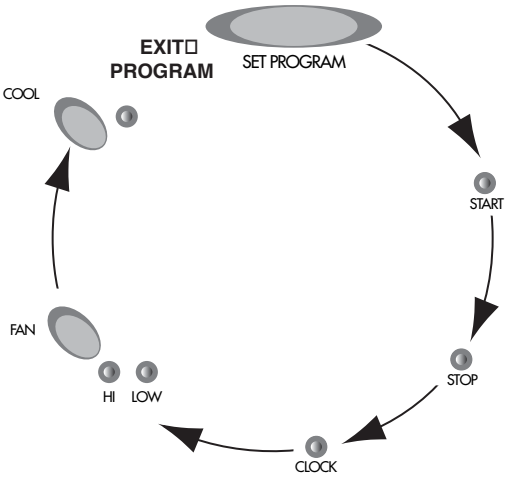

Note:

- ***To cancel a program while running, press***

and

simultaneously. All other buttons are inoperable while a program is running.

OPERATION (cont.)

Operating Modes

The Office Pro 10 operates in two modes, Fan Only and COOL. When in Fan Only mode, the unit circulates the surrounding air. When in COOL mode, the compressor is operational and cool air is circulated.

- ***COOL Mode***

  The unit will operate in Fan Only mode for approximately 120 seconds before the compressor engages. (Time delay setting is 120 ± 15 seconds.)

- ***Temperature Control***

  The room temperature thermistor allows the unit to switch automatically between COOL and Fan Only modes. This is dependent upon inlet air temperature versus set point temperature.

- ***Fan Mode Control DIP Switch***

  The Fan Mode Control DIP Switch determines whether the FAN will continue to operate or stop when the compressor cycles off. (Set point temperature equals inlet air or room temperature.) The unit has been preset at the factory for continuous fan operation.

- ***Temperature Scale Display DIP Switch***

  The Temperature Scale Display DIP Switch changes the temperature(s) that are displayed to either °C or °F. The unit has been preset from the factory to display the temperature(s) in °F.

NOTE: If you wish to change the fan mode operation (COOL⇨OPERATE to COOL⇨STOP), and/or the Temperature Scale Display (°F to °C), contact your MovinCool reseller.

OPERATION (cont.)

Emptying the Drain Tank

During COOL mode, condensate will accumulate in the drain tank. When the drain tank becomes full, TANK FULL will flash and the unit will shut off automatically.

NOTE: If you want to empty the drain tank, while the unit is in operation, press COOL to turn the unit off. If a program is running, you must first press RUN PROGRAM and SET PROGRAM simultaneously.

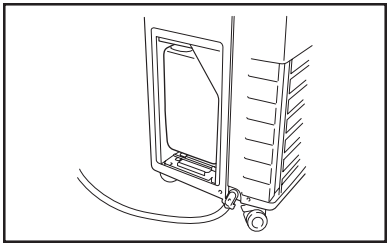

Remove the drain tank panel.

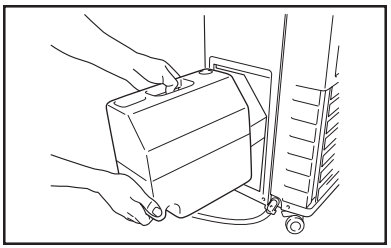

Pull the drain tank from the unit.

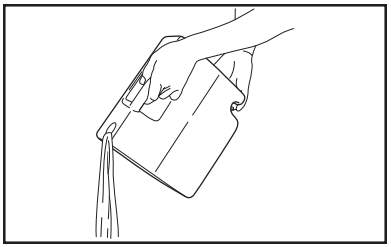

Empty the drain tank into a sink.

After it has been emptied, return the drain tank to the unit.

Reinstall the drain tank panel.

If the RUN PROGRAM LED is flashing, press RUN PROGRAM to continue running the program. If the RUN PROGRAM LED is illuminated continuously, no further steps are necessary. If no program exists or the program was deactivated, press COOL to restart the unit.

NOTE: Do not fill the drain tank with water.

OPERATION (cont.)

Installing the Condenser Plenum and Reducer

- Align the three notches at the base of the unit with the three tabs of the condenser plenum. Fit all three into place and tilt condenser plenum up toward the unit.

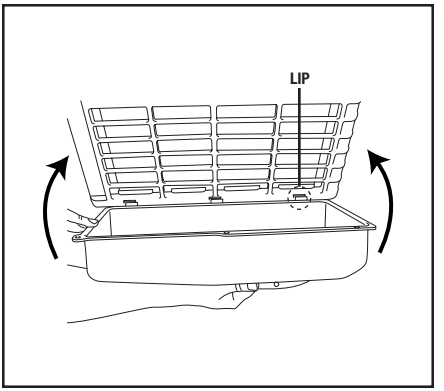

- Use the three longer screws provided and screw the condenser plenum into place, turning clockwise to tighten. Tighten to 1.6 lbs•in torque or until secure.

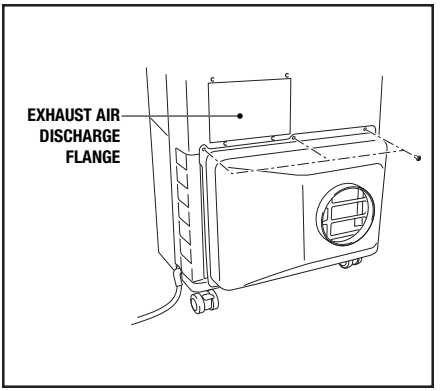

- Align the reducers' four (4) screw holes to the four (4) screw holes of the exhaust air discharge flange. Fasten the screws into place with a Phillips head screw driver, turning clockwise to tighten. Tighten until secure.

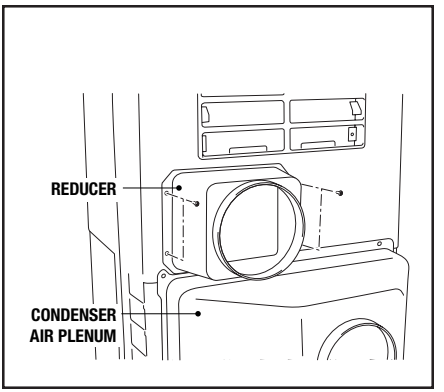

OPERATION (cont.)

Accessory Kit

The window kit consists of the following:

REDUCERS (3)	
*** DUCT CONNECTOR (4)**	
*** (ø6") 5 FT FLEXIBLE DUCT** *** (ø6") 5 FT FLEXIBLE DUCT**	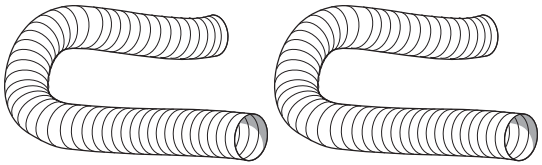
CONDENSER AIR PLENUM	
WINDOW SPACER	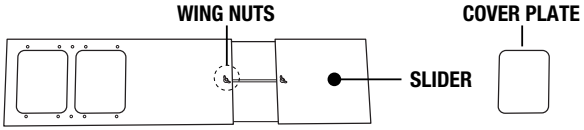
SCREWS (13)	

**** Note: Flexible duct & duct connectors will come preassembled from factory.***

OPERATION (cont.)

Accessory Kit Instructions

Attach reducers to the window spacer by screwing them in place.

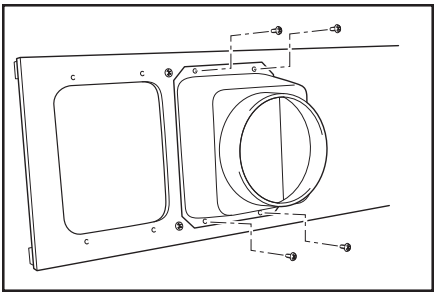

Open the window approximately thirteen (13) inches.

Slide the window spacer into the space to fit the width of the window. Adjust slider by loosening the wing nuts and slide to fit.

Note: See illustrations for different window types.

Slowly lower (slide) and secure the window into place with reducers attached (not shown in illustration).

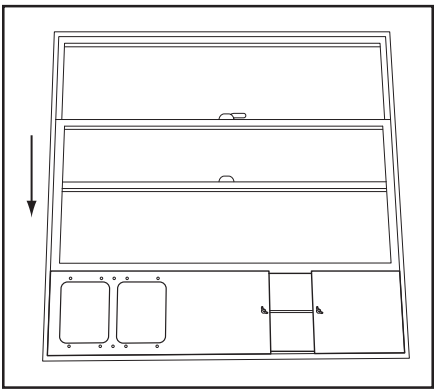

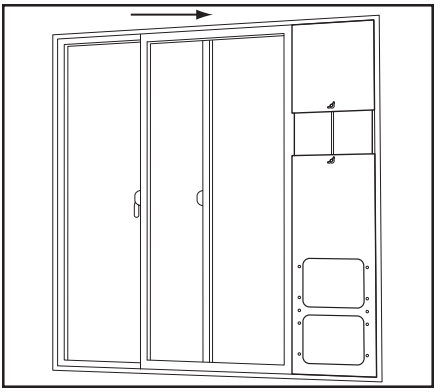

OPERATION (cont.)

Accessory Kit Instructions (Cont.)

Attach duct and duct connector to the reducer by aligning the catches with the knobs and turn counterclockwise to lock in place.

Note: Turn duct connector clockwise to remove from duct.

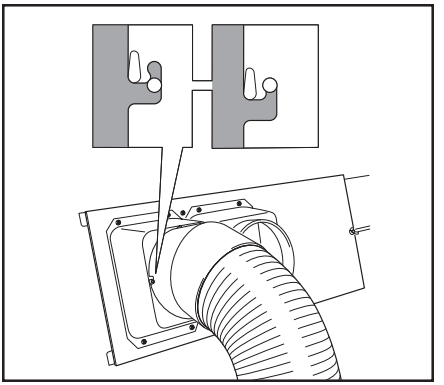

Connect the other end of the duct assembly to the unit by aligning the catch and knobs and turn counterclockwise.

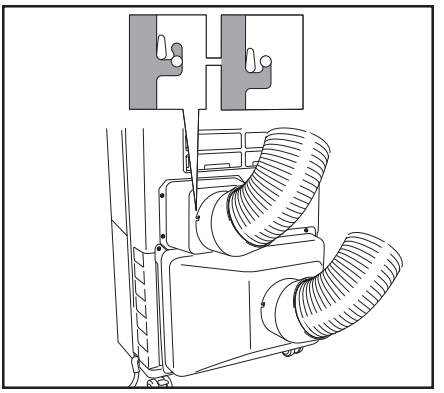

⚠Warning: Do not install this accessory kit on any window facing outdoors. Rain penetrating through the ducts may cause slippery floors or electrical shock. Strong winds may blow this accessory kit away and cause injury. This accessory kit does not prevent unauthorized entry into the building. Small pests may enter into the ducts.

OPERATION (cont.)

Remote Control (Optional)

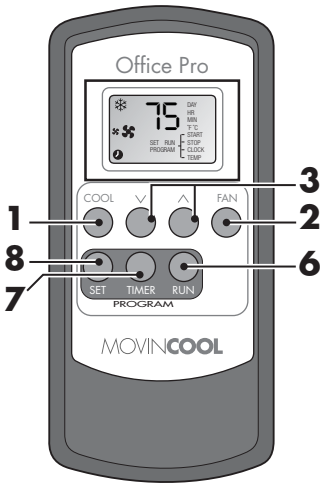

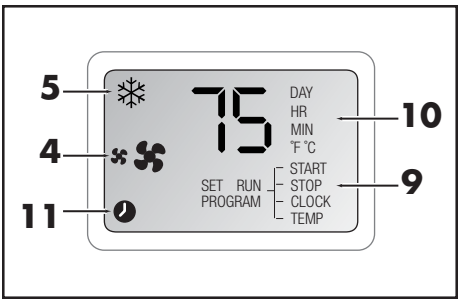

NOTE: If LO appears in the info display area, the lowest set point temperature has been entered. If HI appears in the info display area, the highest set point temperature has been entered.

1	**COOL** Button	Activates/deactivates the COOL mode/ turns the unit off.
2	**FAN** Button	Activates/deactivates the HIGH or LOW fan mode. Turns the unit off (Fan only mode)
3	Set Temperature Buttons (∨/∧)	Increases/decreases the temperature set point; also used to change the day of the week, hours and minutes when programming.
4	Fan Display	Indicates the high, low or fan off modes.
5	Cool On/Off Display	Displays a cool mode symbol when unit is on or off.
6	**RUN** Button	Runs the current program.
7	TIMER Button	Used to set the day and time in hours and minutes.
8	**SET** Button	Used to set the program entry.
9	**SET PROGRAM** Display Area	Used to display the set programming for set, run, start, stop, clock and temperature functions.
10	Info Display Area	Displays the set point temperature; also used during the programming mode for display of days, hours and minutes.
11	Clock Display	Displays a clock during the programming mode. To indicate clock is being set.

Note: Press SET PROGRAM and RUN simultaneously to exit SET PROGRAM and RUN program

OPERATION (cont.)

Drain Pump Kit (Optional)

A drain pump kit (CPK-7) is available to allow continuous operation and to eliminate the need for a drain tank.

- When the water collects to level (A) in the pump reservoir, the drain pump begins to operate and discharges the water.

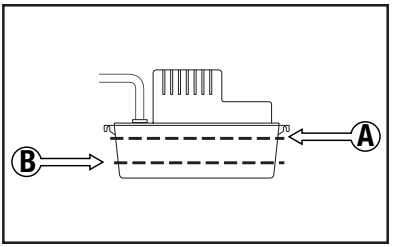

NOTE: The compressor will not operate while the drain pump is discharging water. The info display area will show AU code while the pump is discharging the water. When the pump has discharged the water from the reservoir the AU code will no longer be displayed.

- When the water level drops below level (B), the drain pump stops, and the compressor will restart.

NOTE: If the Fan Mode Control DIP Switch (see pg. 16) is set to the STOP position, the entire unit (including fan operation) will turn off when the drain pump is discharging water.

NOTE: Before a drain pump can be installed, a pump attachment plate must be attached to the base of the pump. This pump plate must then be secured to the base of the unit. Do not install the condensate pump without the pump plate.

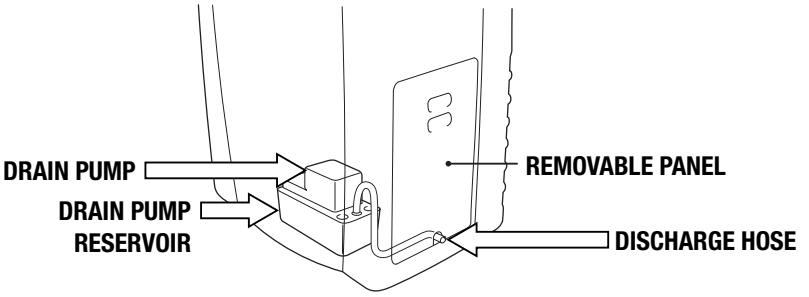

DAILY INSPECTION & MAINTENANCE

Emptying the Drain Tank

To empty the drain tank, refer to the instructions on page 17.

Cleaning the Air Filters

Clean the air filters once a week. If the unit is used in a dusty environment, more frequent cleaning may be required.

A dirty air filter reduces air output resulting in a decrease of the cooling capacity.

Filter Removal Method

- Turn the unit off by pressing COOL. If a program is running, you must first press RUN PROGRAM and SET PROGRAM simultaneously.
- Remove the two air filters.

NOTE: To remove the filters from the Office Pro 10, slide the evaporator filter up, then slide the condenser filter to the left as shown.

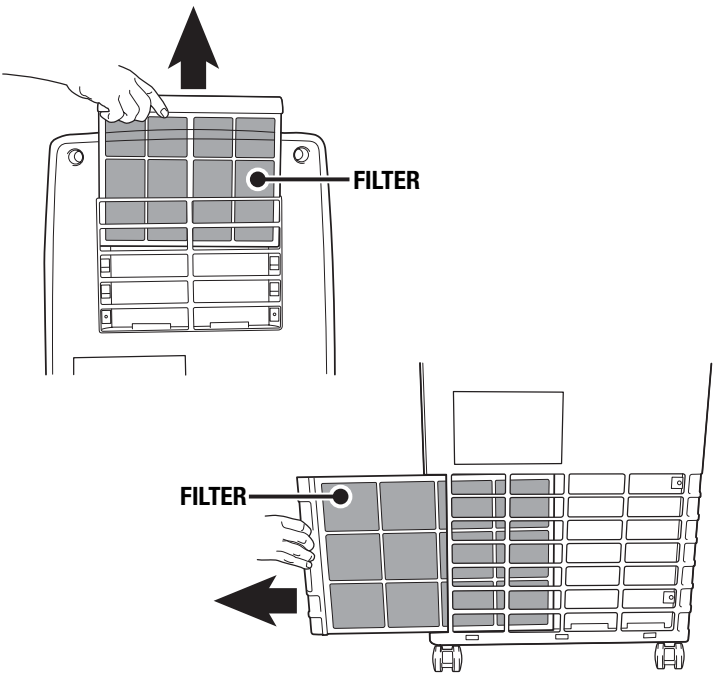

DAILY INSPECTION & MAINTENANCE (cont.)

Filter Cleaning Method

- Remove dust from the element with a vacuum cleaner, or rinse in cold or lukewarm water. If the element is extremely dirty, wash with a neutral detergent.
- After the element has been cleaned, rinse with clean running water, allow to dry, then reinstall.

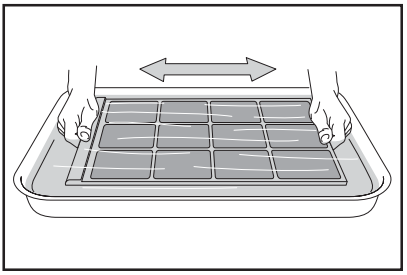

In-Season/Off-Season Inspection & Maintenance

■ ***In-Season***

- Check the prongs and surface of the power cord plug for dust and/or dirt. If dust and/or dirt are present, wipe off with a clean, dry cloth.
- Check the power cord, plug and prongs for damage or excess play. If any damage or excess play is found, contact your MovinCool reseller for repair.
- Check the air filters and drain tank.
- Clean the outside of the unit with a damp cloth or mild nonabrasive cleaner.

■ ***Off-Season***

- Operate the unit in Fan Only mode for 8 hours.

Note: Operation is necessary to dry out the inside of the unit.

- Disconnect the power cord from the AC outlet.
- Check the prongs and surface of the power cord plug for dust and/or dirt. If dust and/or dirt are present, wipe off with a clean, dry cloth.
- Check the power cord, plug and prongs for damage or excess play. If any damage or excess play is found, contact your MovinCool reseller for repair.
- Clean the air filters.
- Empty all water from the drain tank.

TROUBLESHOOTING

Self-Diagnostic Codes

Self-Diagnostic Codes will be displayed on the Control Board under the following conditions:

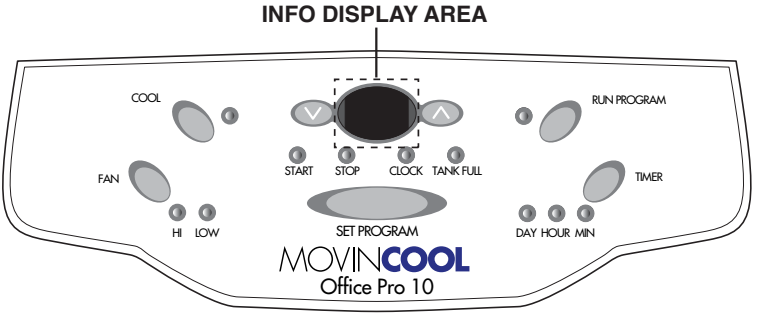

Code	Condition
DF	When the evaporator thermistor disengages the compressor.
FL	When the drain tank switch shuts off the unit (TANK FULL flashes).
AU	When unit disengages the compressor while the condensate pump is discharging water.
LO	Lowest temperature set point.
HI	Highest temperature set point.

Note: When a self-diagnostic code is displayed the room temperature will not be displayed. If HP is displayed, call your MovinCool Reseller/Distributor.

Check the following points before calling a qualified technician.

SYMPTOM	POSSIBLE CAUSE	REMEDY
Unit does not operate	• Ground fault breaker tripped • Drain tank is full (TANK FULL will be flashing)	Reset breaker Empty the drain tank
Insufficient cooling	• Dirty/blocked air filters • Air inlet/outlet blocked • Improper temperature setting	Clean air filters Clear air inlet/outlet Set to desired position

If symptoms persist after the above actions have been taken, turn the unit off, disconnect the power cord plug and contact your MovinCool reseller.

TECHNICAL SPECIFICATIONS

ITEM/FEATURES		Office Pro 10
Rating Conditions		
dry bulb		95° F (35° C)
wet bulb		83° F (28.2° C)
humidity		(60%)
Specifications		
power frequency		60Hz
line voltage		single phase 115 V
power consumption		1.25 KW
current consumption		11.5 Amps
power factor		95%
starting current		40A
power wiring		14 (3-core) AWG
Cooling Unit		
cooling capability		2,440 Kcal/hr 9,600 BTU/hr
cooling system		direct expansion
Blower		
type of fan:	Evaporator	centrifugal fan
	Condenser	turbo fan
air volume:	Evaporator (High speed)	595 ft ^{3}/min (1,006 m^3/h)
	Evaporator (Low speed)	510 ft ^{3}/min (862 m^3/h)
	Condenser	1160 ft ^{3}/min (1,971 m^3/h)
motor output:	Evaporator (High)	0.08 KW
	Evaporator (Low)	0.05 KW
	Condenser	0.08 KW
Compressor		
type		rotary
output		0.68 Kw
refrigerant type		R-22
refrigerant capacity		1.61 lbs (0.71 kg)
Safety Devices		
compressor overload protector		included
anti-freezing thermistor		included
full drain tank switch		included
automatic restart (power interruption)		included
compressor time delay program		included
Dimensions & Weight		
W x D x H (in)		22" x 14" x 38"
W x D x H (mm)		559 x 356 x 965
weight (lbs/kg)		130 / 59
Operating Conditions		
inlet air (relative humidity)		95° F (35° C), ≤ 50% 65° F (18.3° C), ≥ 60%
Control Device		
temperature control		included
programmable timer		included
two speed fan		included

MOVINCOOL®
THE PORTABLE SPOT COOLING SOLUTION

LIMITED WARRANTY

DENSO SALES CALIFORNIA, INC. ("DENSO") warrants its MOVINCOOL Products only to the extent stated in its official written warranties. Unless otherwise specifically provided in writing by DENSO, DENSO warrants to end-user that the Products shall be free of defects in materials or workmanship and will function in accordance with DENSO's published specifications under ordinary intended use and service for a period of twelve (12) months after delivery to the end-user; provided, however, in the case of the compressor element of the Products such warranty shall be for a period of thirty six (36) months after delivery to the end-user. DENSO shall, at its sole option, repair or replace any defective Product covered by this warranty. Such remedy shall be end-user's sole remedy with respect to any particular defect in the Products.

This warranty does not cover defects or malfunctions which result from causes beyond DENSO's control, including, without limitation, (i) unusual physical or electrical stress; (ii) accident, neglect, abuse, misuse or other abnormal use; (iii) failure to perform routine maintenance in accordance with DENSO'S recommended procedures; (iv) normal wear and tear; (v) repairs or attempted repairs by an unauthorized person; (vi) modifications or alterations to the Products; (vii) use with supplies or devices not supplied or approved by DENSO; or (viii) improper servicing. This warranty shall extend only to the original end-user and shall be void if any labels or other identifying marks permanently affixed to Products when shipped by DENSO are removed, altered, defaced or obliterated.

The aforesaid warranty is the only warranty made by DENSO with respect to the Products and is in lieu of all obligations or liabilities on the part of DENSO for damages arising out of or in connection with the sale, use or performance of the Products, including, without limitation, any lost profits or any other consequential, incidental, special or exemplary damages of any kind. DENSO DISCLAIMS ALL OTHER WARRANTIES WITH REGARD TO THE PRODUCTS, INCLUDING ALL IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR USE. THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION CONTAINED HEREIN.

PURCHASE DATE: _____

SERIAL NUMBER: _____

⇩ DETACH HERE ⇩

MOVINCOOL® **REGISTRATION CARD**

OWNER INFORMATION

Company _____

Contact _____

Title _____

Address _____

City/State/Zip _____

Phone _____ FAX _____

E-Mail _____

Date of Purchase _____

Model No. (check one)

❑ Classic 10 ❑ Classic Plus 14 ❑ Office Pro 10
❑ Classic 18 ❑ Classic Plus 26 ❑ Office Pro 12
❑ Classic 40 ❑ Office Pro 18
❑ Classic 60 ❑ Office Pro 24
❑ Office Pro 60

Serial No. (on side panel) _____

DEALER NAME _____

DEALER LOCATION _____

What is your type of business?
❑ Banking/Finance
❑ Education
❑ Government/Military
❑ Hospital/Healthcare
❑ Restaurant/Foodservice
❑ Sales/Marketing
❑ Manufacturing–plastics
❑ Manufacturing–metals
❑ Manufacturing–paper/wood products
❑ Manufacturing–electronics/electrical components
❑ Manufacturing–other _____
❑ Utility

How did you first hear about MovinCool?
❑ Magazine Ad
❑ Magazine Article
❑ Direct Mail
❑ Postcard Deck
❑ Trade Show
❑ Referral
❑ Other _____

What factors most influenced your decision to purchase a MovinCool?
❑ Product Quality
❑ Price
❑ Portability
❑ Ease of Installation
❑ Energy Savings
❑ Versatility

Have you previously purchased a MovinCool?
❑ Yes ❑ No

If yes, how many units do you own? _____

What is the primary use for this unit?
❑ Cooling people
❑ Cooling equipment
❑ Cooling a process
❑ Other _____

Where is the unit used?
❑ Office
❑ Manufacturing or Warehouse
❑ Hospital/Laboratory
❑ Computer/Equipment Room
❑ Kitchen/Laundry
❑ Special Events/Outdoors
❑ Other _____

Comments _____

DENSO

DENSO SALES CALIFORNIA, INC.
3900 Via Oro Avenue
Long Beach CA 90810-1868
800-264-9573 / 310-834-6352
www.movincool.com

Technical Services Department
DSCA P/N: LA990009-1184
GAC P/N: LA484007-1450

First Issue: March 2003
Printed in the U.S.A.

NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

BUSINESS REPLY MAIL
FIRST-CLASS MAIL PERMIT NO. 8390 LONG BEACH, CA
POSTAGE WILL BE PAID BY ADDRESSEE

MOVINCOOL®
Pioneering New Solutions With Portable Air-Conditioning

DENSO SALES CALIFORNIA, INC.
3900 VIA ORO AVENUE
LONG BEACH CA 90810-9969